



NOTES:

- 1) ZONES IDENTICAL ON EITHER SIDE OF THE CENTERLINE AS SHOWN BELOW
- 2) REQUIREMENTS OF THE STATE OF CALIFORNIA, HEALTH AND WELFARE AGENCY, DEPARTMENT OF HEALTH SERVICES
- 3) SEE STD NO. 31 FOR NOTES ON WATER, RECYCLED WATER AND SEWER MAIN PARALLEL AND PERPENDICULAR SEPARATIONS
- 4) REFER TO THE NMWD STANDARDS SPECIFICATION 15151 FOR PIPE SEPARATION REQUIREMENTS

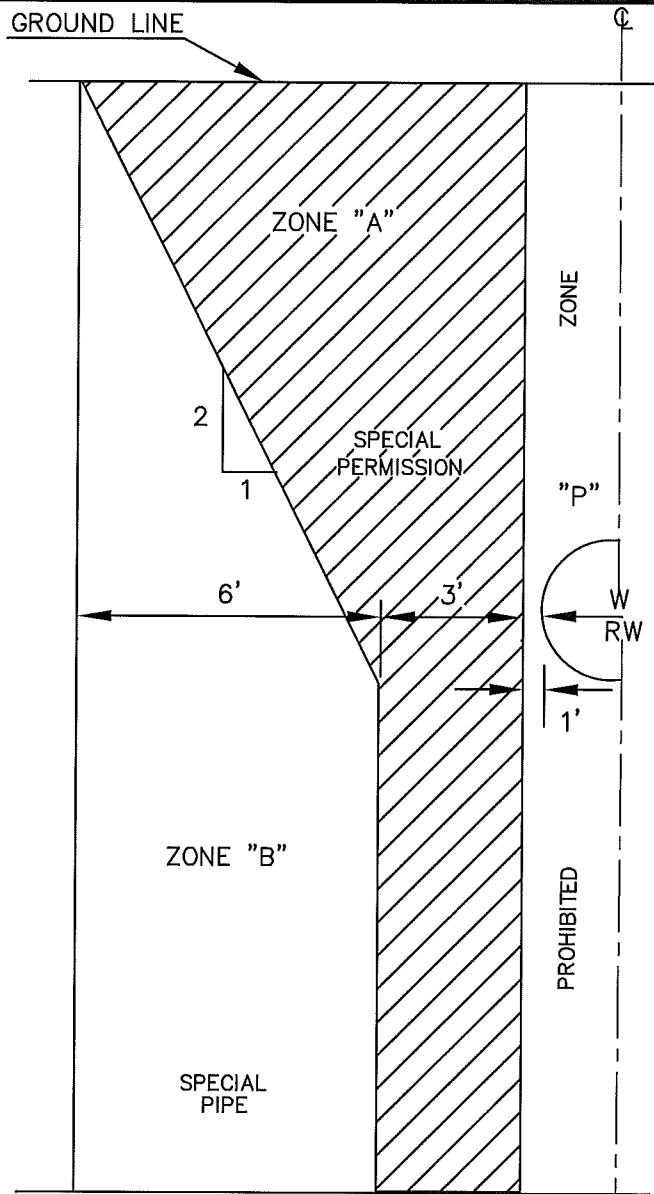

CASE 1
NEW RECYCLED WATER
OR
NEW SEWER

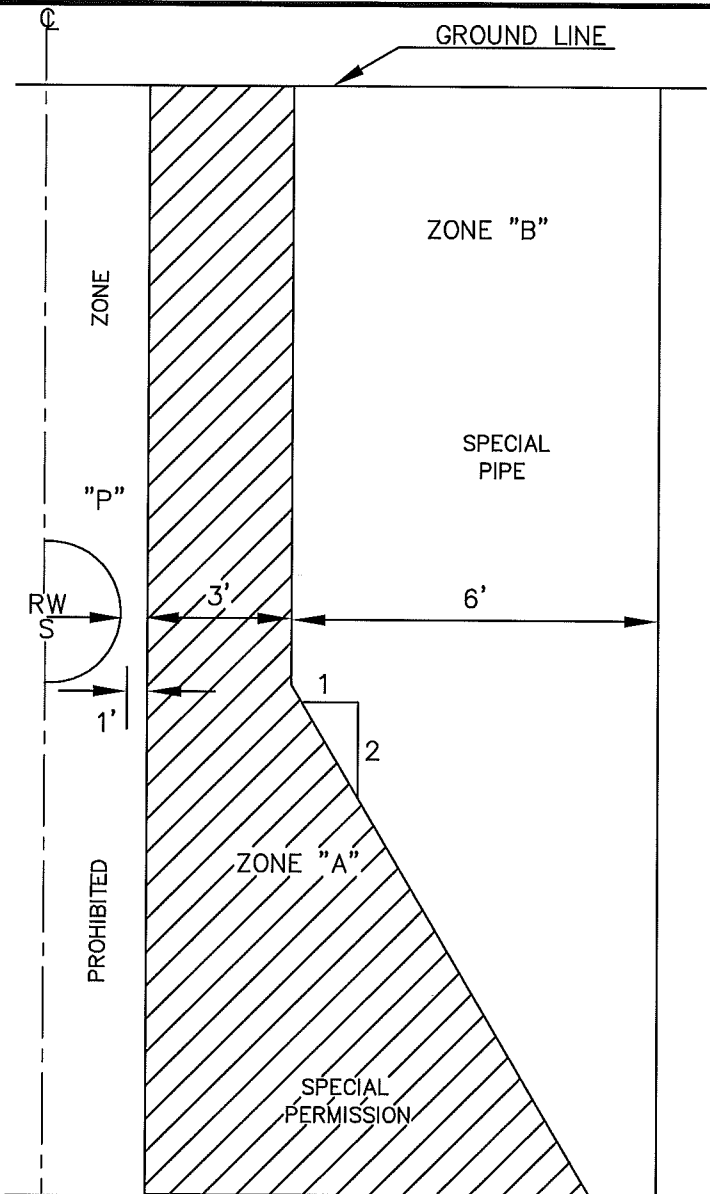

CASE 2
NEW POTABLE WATER
OR
NEW RECYCLED WATER

NORTH MARIN WATER DISTRICT
NOVATO, CALIFORNIA

WATER, RECYCLED WATER AND SEWER
MAIN PARALLEL SEPARATIONS

APPROVED	DATE	REV.	STD. NO.
<i>LM</i>	12/28/10	0	NO. 29